
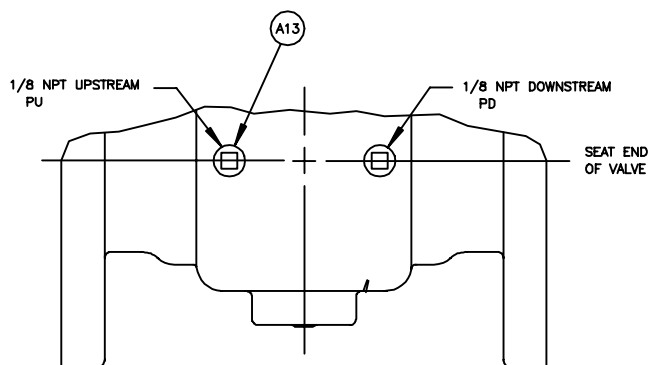


NO.	PART NAME	QTY.
A1	BODY	1
A2	BEARING (BODY)	1
A3	PLUG	1
A5	GASKET (BODY)	1
A6	BONNET	1
A7	BEARING (BONNET)	1
A8	SCREW (SEE NOTE 6)	4
A8	STUD (SEE NOTE 6)	4
A9	FELT WASHER (LV, MNA, NT ACT'RS ONLY)	1
A10	U-RING SEAL (STEM SEAL OPTION NBR & FKM)	1
A10	WASHER (STEM SEAL OPTION T)	1
A10	SEAL (STEM SEAL OPTION G2)	1
A11	U-RING FILLER (STEM SEAL OPTION NBR & FKM)	1
A12	STUD (SEE NOTE 4)	1
A13	PIPE PLUG (PU & PD)	1
A14	CAUTION TAG	1
A15	NUT (SEE NOTE 6)	4

NOTE:

1. RECOMMENDED SPARE PARTS ARE ITEMS NUMBER A3, PLUG (IF RUBBER FACED), A5, A9, A10 AND A11.
2. WHEN ORDERING PARTS, SPECIFY VALVE SIZE AND MODEL NUMBER FROM DATA PLATE, ALSO GIVE DRAWING NUMBER WITH PART NAME, ITEM NUMBER AND QUANTITY.
3. CLOCKWISE ROTATION OF PLUG STEM CLOSSES VALVE.
4. VALVE IS STOCKED WITH STUD FOR USE WITH MANUAL ACTUATORS (LV, NT AND MNA). STUD REQUIRED FOR POWER ACTUATORS WILL BE REPLACED AT ACTUATOR LEVEL.
5. HARD RUBBER LINED IS AVAILABLE ON THE SIZE 3 FLANGED VALVE ONLY. BEARINGS, ITEMS # A2 AND A7 ARE NON-REPLACEABLE RUBBER BEARINGS ON THE HARD RUBBER LINED VALVE.
6. WHEN VALVE IS SUPPLIED WITH ISO F10 ACTUATOR ADAPTOR ON 1/2" THRU 2" VALVES, SCREW (A8) IS REPLACED WITH A STUD AND NUT (A15) IS REQUIRED.

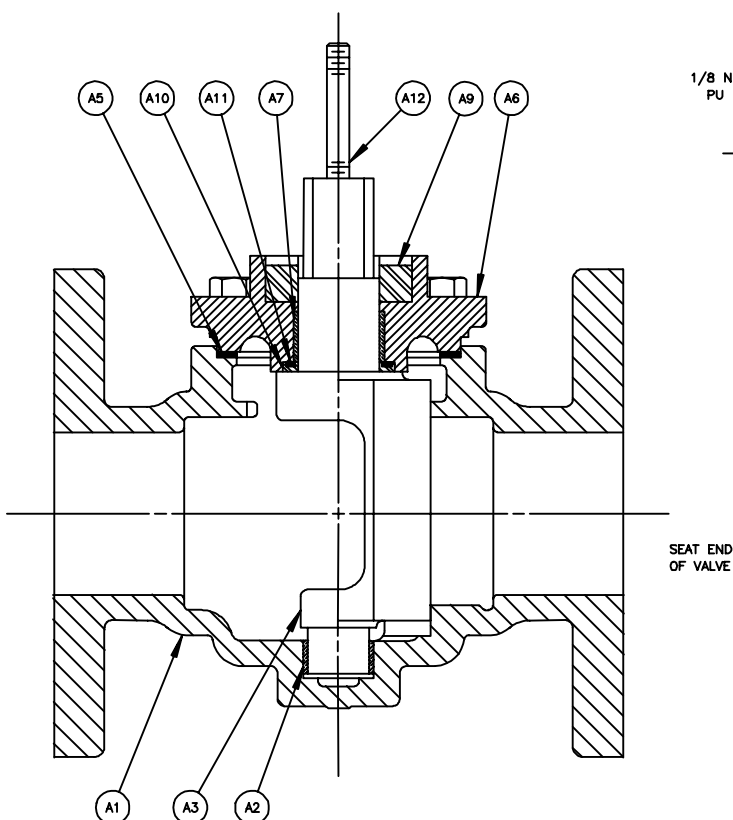

ALTERNATE VIEW SHOWING  
PU OR PD

0	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99
---	---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----

**DeZURIK**  
SARTELL, MINNESOTA, U.S.A. 55377  
CAMBRIDGE, ONTARIO, CANADA

VALVE ASSEMBLY SIZE 1/2" - 3" PEC VALVES, FLANGED, ALL EXCEPT CIS			
DOCT. CODE	DRAWN	JUN	APPROVED
C1	CHECKED	TK	TK
		DATE	02/06/98

A-50041